


SECTION THROUGH
STANDARD CURB, GUTTER AND ATTACHED SIDEWALK
N.T.S

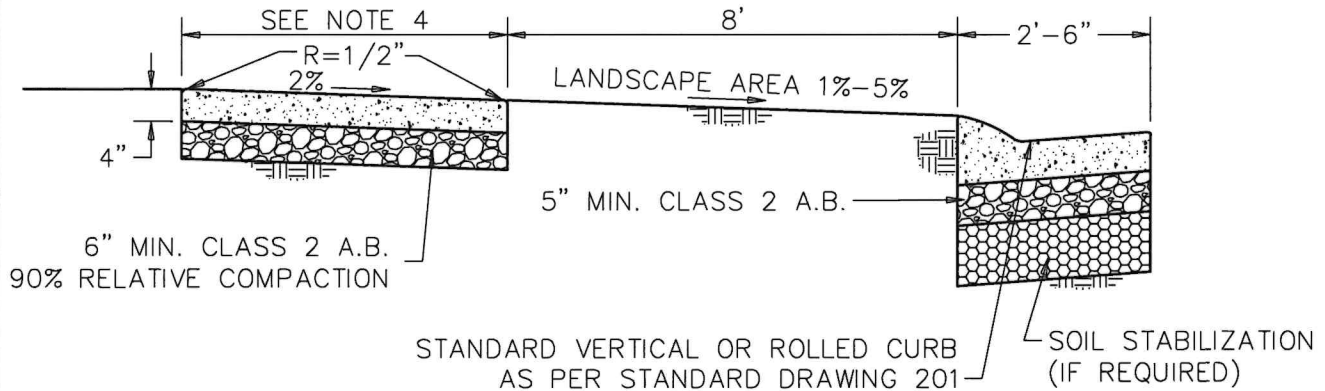

SECTION THROUGH
STANDARD CURB, GUTTER AND DETACHED SIDEWALK
N.T.S

NOTES:

1. CONCRETE TO BE MINOR CONCRETE PER CALTRANS SPEC.
2. TOP 12" OF SUBGRADE AND A.B. LAYER SHALL BE COMPACTED TO 90% RELATIVE COMPACTION FOR SIDEWALKS AND 95% FOR CURB AND GUTTER.
3. ALTERNATIVE SIDEWALK SECTION - 6" CONCRETE ON 4" SAND OR CLASS 2 A.B.
4. MINIMUM SIDEWALK WIDTHS SHALL BE 4' FOR RESIDENTIAL STREETS AND 6' FOR COLLECTORS, SCHOOLS, PARKS AND COMMERCIAL LOTS. SIDEWALK TO BE POURED SEPARATELY FROM CURB UNLESS OTHERWISE APPROVED BY THE COUNTY. DO NOT DOWEL CURB TO SIDEWALK.
5. NO PULL BOX, UTILITY VAULT, UTILITY POLE, MANHOLE OR OTHER OBSTRUCTIONS SHALL BE LOCATED WITHIN SIDEWALK OR RAMP AREA (RETURN TO RETURN).
6. ALL CROSSINGS UNDER SIDEWALKS AND CURB AND GUTTER SHALL BE INSTALLED PRIOR TO PLACING CONCRETE.
7. EXPANSION JOINTS NOT TO EXCEED 20' SPACING FOR SIDEWALKS AND 40' SPACING FOR CURB AND GUTTER.
8. EXPANSION JOINT SHALL BE FILLED WITH 1/2" MIN. THICK PREFORMED JOINT FILLER AS PER CALTRANS SPECIFICATIONS AND BE THE FULL DEPTH OF CONCRETE.
9. SEE STANDARD 208 FOR CONCRETE JOINT & FINISH DETAILS.
10. IF SOIL STABILIZATION IS REQUIRED, EXTEND TO BACK OF WALK FOR ATTACHED SIDEWALK.

YUBA COUNTY DEPARTMENT OF PUBLIC WORKS	
STANDARD CURB, GUTTER AND SIDEWALK	
APPROVED BY: <i>David A. Peterson</i>	DATE: 8/11/22
202	